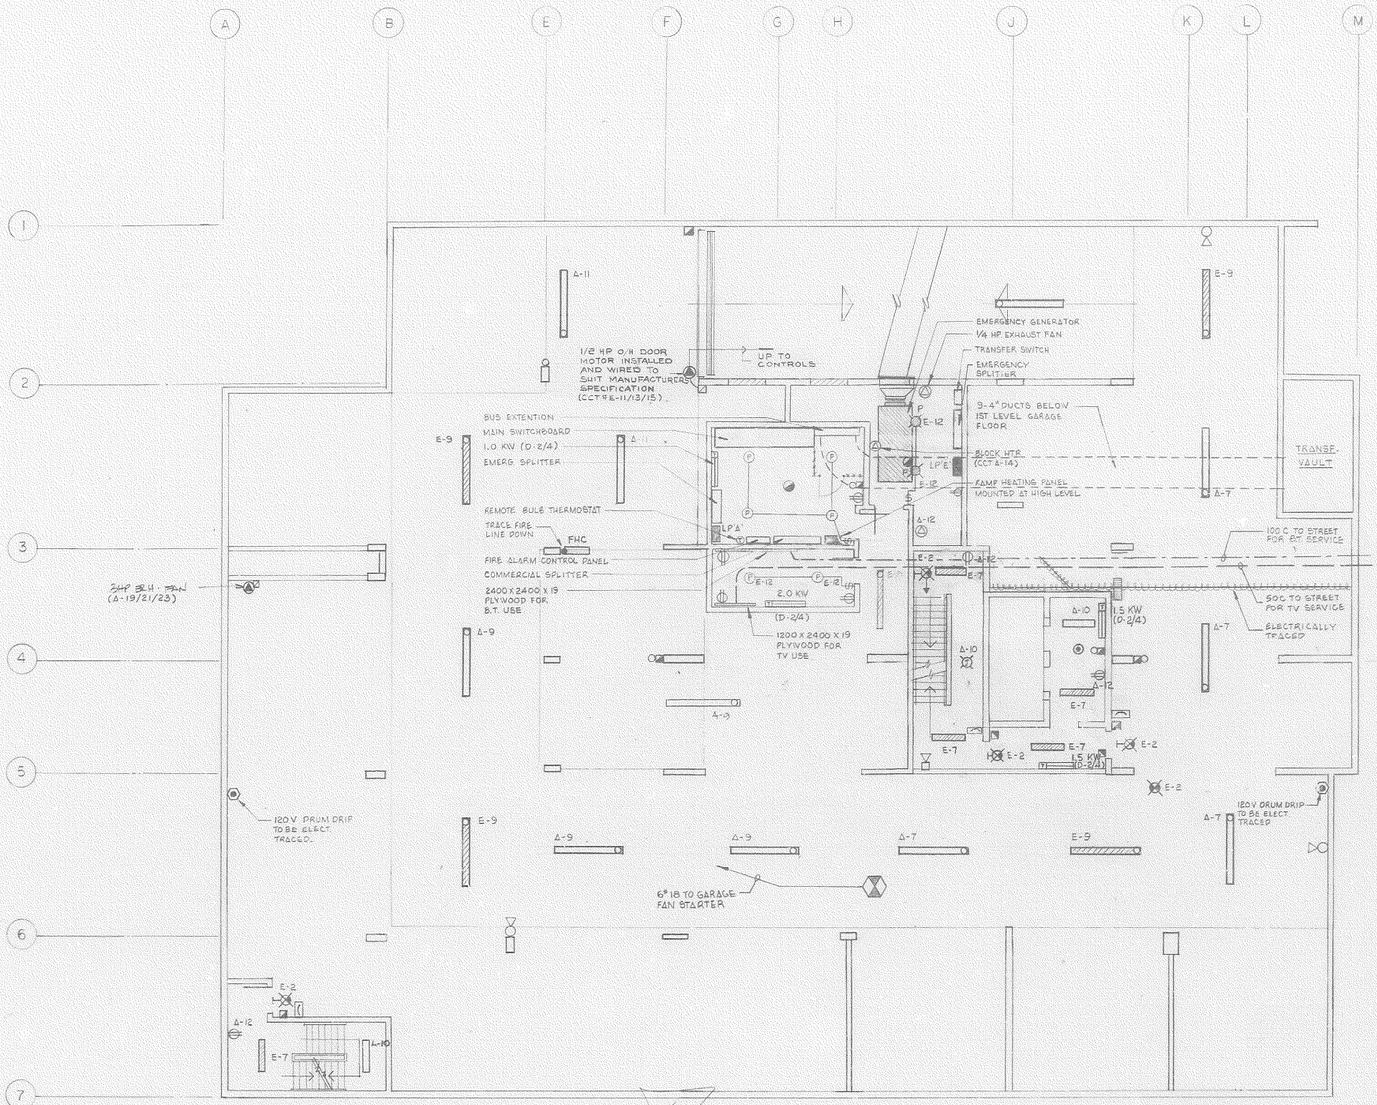

1 LIGHTING FIXTURE SCHEDULE

TYPE	DESCRIPTION

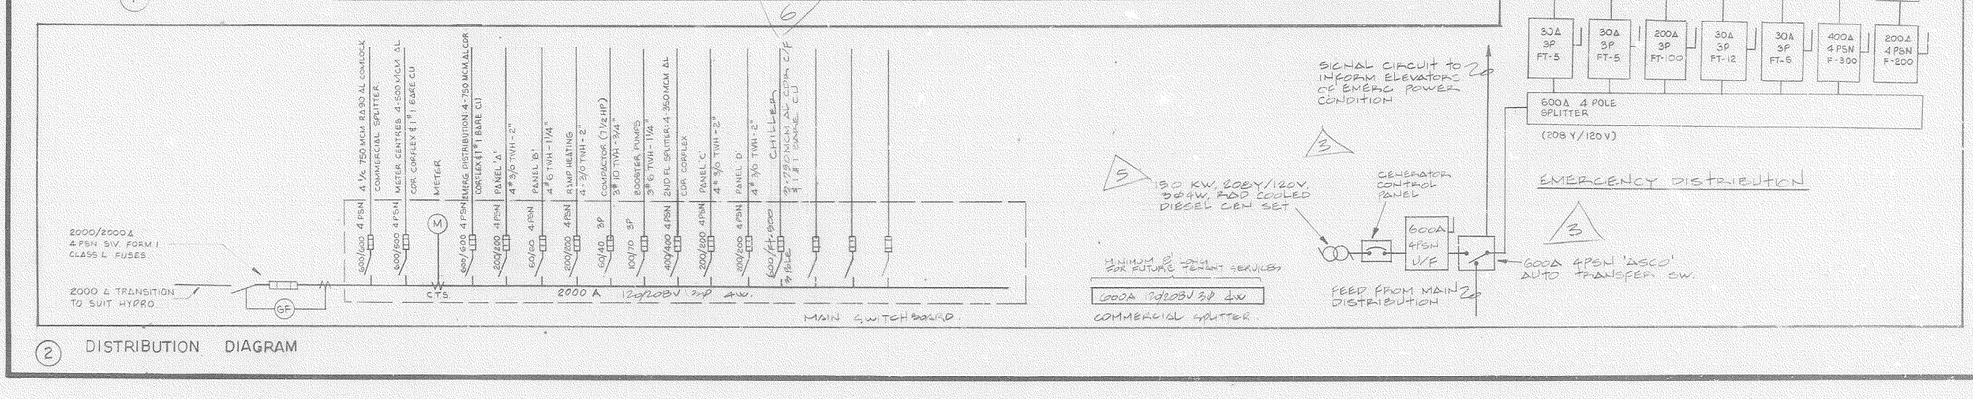

2 DISTRIBUTION DIAGRAM

NOTES

1. ALL FLUORESCENT LIGHTING FIXTURES SHALL BE TYPE 'FF', UNLESS NOTED OTHERWISE.
2. ALL PIPE TRACING SHALL BE INSTALLED AS PER MANUFACTURER'S RECOMMENDATIONS. EXACT PIPE LENGTH SHALL BE DETERMINED ON SITE PRIOR TO ORDERING CABLES TO ENSURE PROPER CABLE IS INSTALLED. EACH HEATING CABLE SHALL BE CONTROLLED BY A REMOTE SENSING BULB THERMOSTAT RAYSTAT CAT #A688. ALL HEATING CABLES SHALL BE AS MANUFACTURED BY RAYSTAT UNLESS OTHERWISE NOTED. ALL DRUM DRIPS SHALL BE HEATED WITH 50W, 208/240 RAYTAPE-19 C/W INSTEN RECEPTACLE BOX C/W WEAR CUTLINE ADJ CO-ORDINATED WITH SPRINKLER CONTRACTOR FOR EXACT LOCATION.

NO.	DATE	DESCRIPTION	DWN.	CHD.
7	OCT 5/81	JOB INSTRUCTION # 1	MR	
6	FEB 25/81	CHANGE NOTICE # 2	CL	
5	SEPT 24, 80	ADDENDUM # 4	CL	
4	AUG 15 1980	ADDENDUM # 2	MR	
3	JUL 23/80	ADDENDUM # 1	CL	
2	JUL 16/80	ELECTRICAL RM. RELOCATION	MR	
1	JUNE 9/80	REISSUED FOR PERMIT	MR	

DESTROY ALL PRINTS DATED PREVIOUS TO FINAL DATE ABOVE.

REVISIONS

THIS DRAWING SHALL ONLY BE USED WHEN SIGNED FOR THE PURPOSE SPECIFIED BELOW.

CONSTRUCTION
TENDER
PERMIT — NOV 23 1979
FOR — DATE — CHECKED BY

SUBMISSIONS

THE SPECIFICATIONS ARE TO BE CONSIDERED AS AN INTEGRAL PART OF THESE DRAWINGS AND NEITHER THE DRAWINGS NOR THE SPECIFICATIONS SHALL BE USED ALONE.

THESE DRAWINGS ARE THE PROPERTY OF THE ENGINEER AND MUST BE RETURNED AT COMPLETION OF WORK TO HIM REQUEST.

THE INTERSIGN ENGINEERING CORP. LTD.
CONSULTING ENGINEERS
TORONTO CALGARY
V. KNOP
REGISTERED PROFESSIONAL ENGINEER PROVINCE OF ONTARIO

PROJECT
53 UNITS
RESIDENTIAL / COMMERCIAL
254 JARVIS STREET
FOR STASH INVESTMENTS INC.
TORONTO ONTARIO

TITLE
FIRST GARAGE LEVEL

DRAWN BY: PS — CHECKED BY: — PROJECT No. 79-095
SCALE: 1 : 100 — DRAWING No. E - 3
DATE: NOV 1979 — OF 8