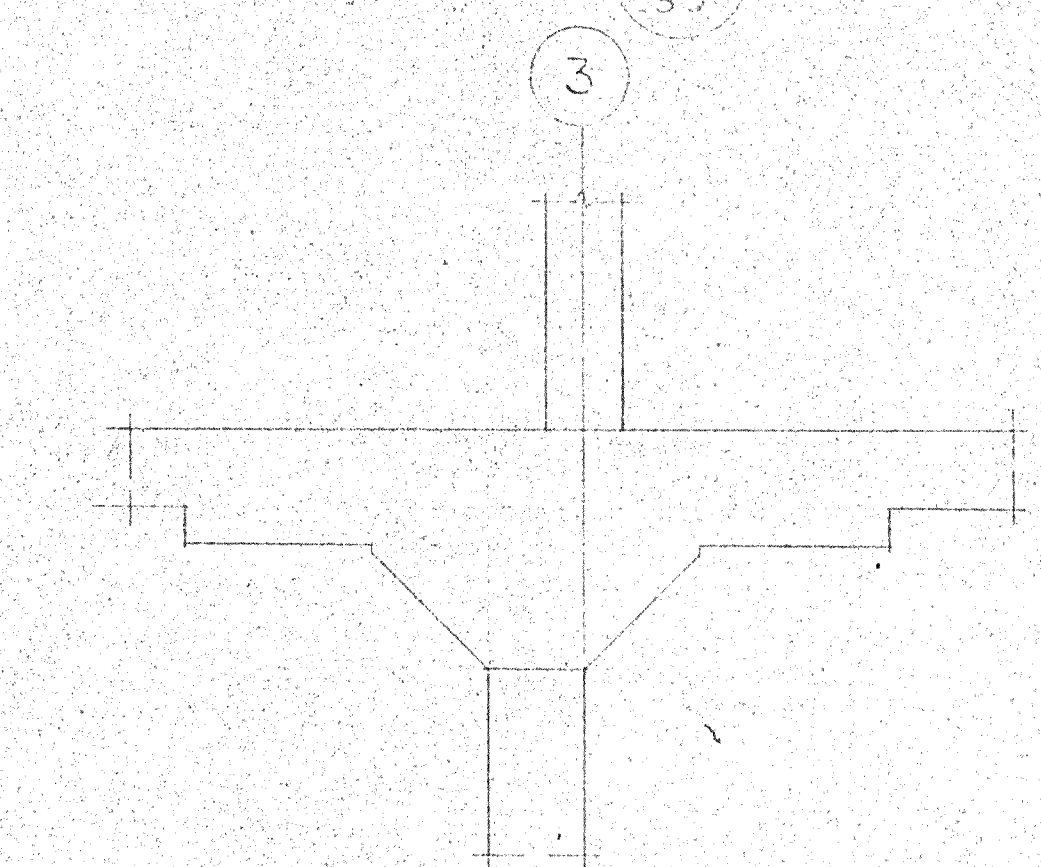
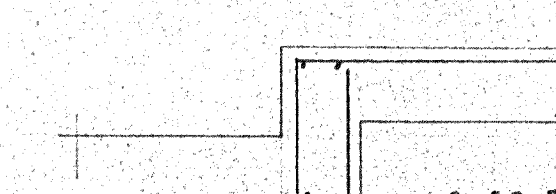
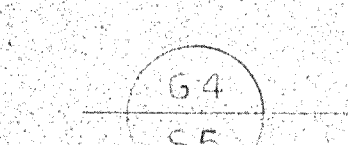
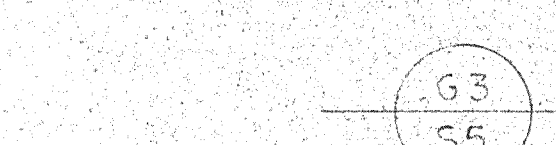
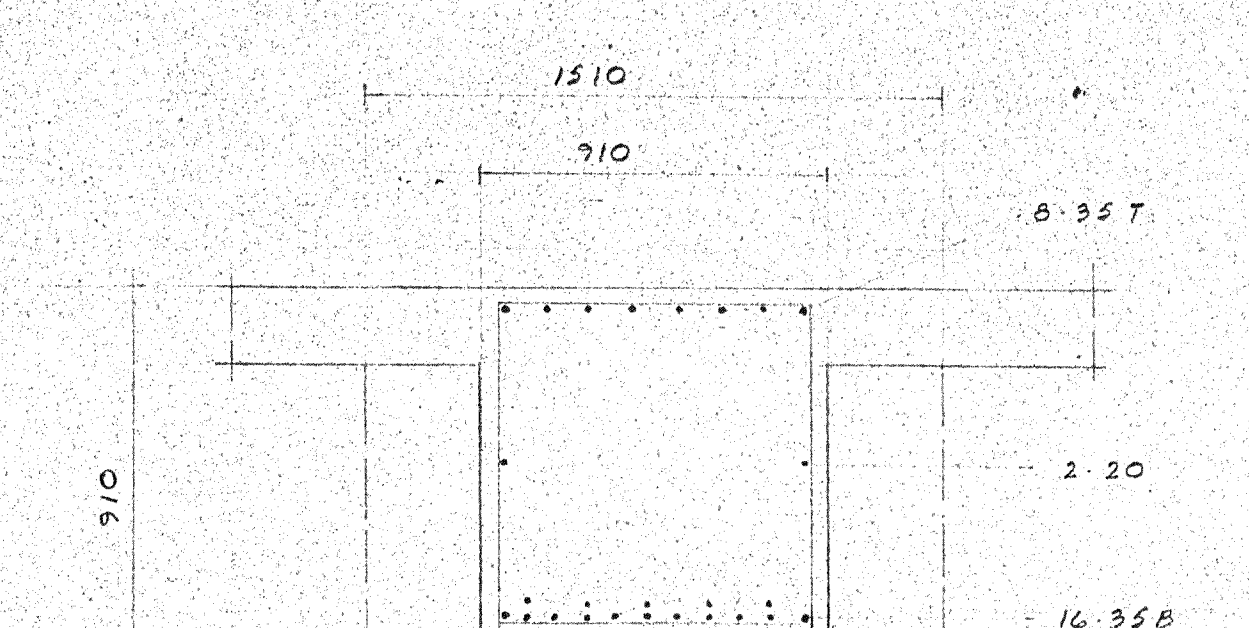
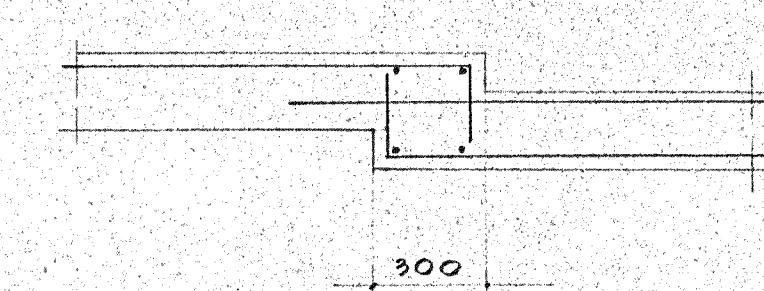

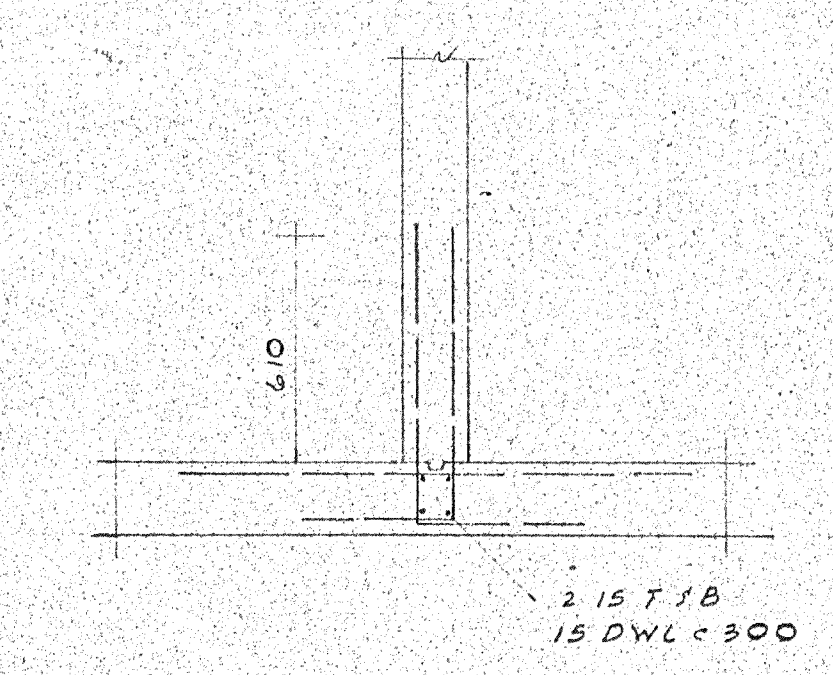
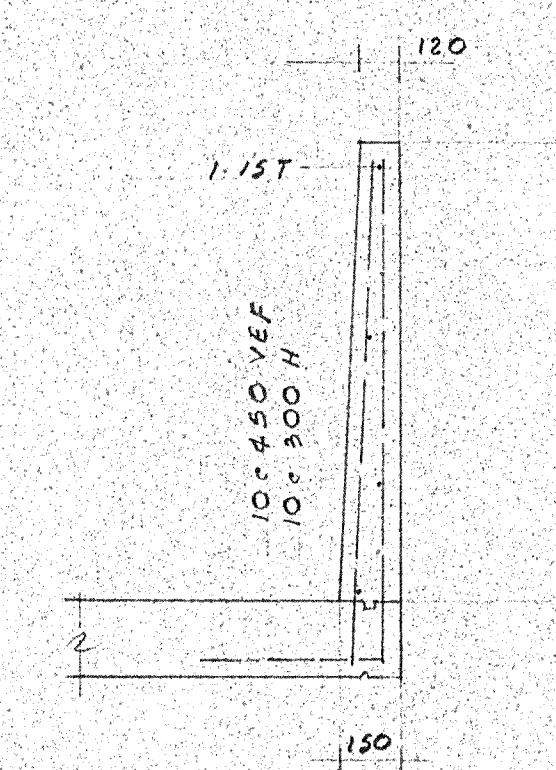
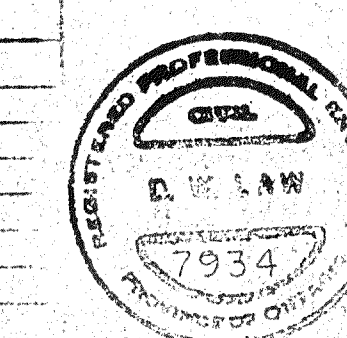


1-100

1. CONCRETE SLAB TO BE 100 THICK UNLESS NOTED. PROP. 100 DP.
2. CONCRETE TO HAVE A COMPRESSIVE STRENGTH OF 4000 P.S.I. GRADE AT 28 DAYS.
3. REINFORCING STEEL TO HAVE A YIELD STRENGTH OF 60,000 P.S.I.
4. ALL REINFORCING STEEL TO BE 10 BAR UNLESS NOTED.
5. REINFORCING STEEL IN $N-S$ DIRECTION TO BE PLACED CLOSEST TO TOP AND BOTTOM SURFACES OF CONCRETE.
6. AT LEAST 50 % OF TOP STEEL IN COLUMN STRIP TO BE PLACED DIRECTLY OVER COLUMN WITHIN A WIDTH EQUAL TO COLUMN WIDTH + 10' EITHER SIDE OF COLUMN.
7. MAXIMUM SPACING OF REINFORCING BARS TO BE
8. ULTIMATE STRENGTH DESIGN HAS BEEN USED.
9. SEE GENERAL NOTES AND TYPICAL DETAILS ON DRAWING 9-10

[illegible]

D. LAW CONSULTANTS LIMITED
CONSULTING STRUCTURAL ENGINEERS
30 SCARSDALE RD. — DON MILLS, ONT.

JOB NAME
COMMERCIAL & APT PROJ
STASH INVEST. INC.
254 JARVIS ST TORONTO

SHEET TITLE		SHEET No.	
GROUND FLOOR		S 5	
ARCHITECT		SCALE	DATE
E I RICHMOND		DRAWN BY	MAY 29/80 CHECKED BY