TYPICAL MECHANICAL EQUIPMENT NOTES.

ITEM.	DESCRIPTION.	LOCATION.	SIZE OR CAPACITY.	NOTES.
1	PERRY A/C LOUVRES	GARBAGE RM.	600 MM x 600 MM	C/W FLYSCREEN LOCATED 300MM BELOW CEILING DUCTED 600 x 300MM DOWN TO 450MM ABOVE FLOOR, FITTED WITH MINIMUM 40 DEGREE 450MM x 300 x 2 OUTSIDE LOUVRE.
2	~~EXHAUST LOUVRES~~	~~GARBAGE RM.~~	~~600 MM x 300MM~~	C/W FLYSCREEN AND BACKDRAFT DAMPER, LOCATED 450MM ABOVE OUTSIDE GRADE.
3	UNIT HEATER	GARBAGE RM. BY ELECT. CONTR.	12 KW (40 MBH)	C/W THERMOSTAT, SUMMER SWITCH, STARTER AND FAN GUARD, MOUNTED AT HIGH LEVEL.
4	PERRY A/C LOUVER	GENERATOR RM.	1200 MM x 600 MM	C/W BIRDSCREEN AND MANUAL DAMPER INTERLOCKED W/ GENERATOR (BY ELECT. CONTR.) LOCATED MIN. 300MM ABOVE FLARE.
5	EXHAUST LOUVER	GENERATOR RM.	900 MM x 900 MM	C/W BIRDSCREEN AND BACKDRAFT DAMPER. LOCATED 300MM ABOVE FLARE.
6	MUFFLER MOD	GENERATOR RM.	200 MM	C/W RESIDENTIAL MUFFLER ALL SUPPLIED BY ELECT. CONTR. INSTALLED BY PLUMBING CONTR.
7	D.F. STORAGE TANK	GENERATOR RM.	227 L. (50 IMP GAL)	SUPPLIED BY ELECT. CONTR. INSTALLED BY PLUMBING CONTR. C/W P&V AND VENT MAIN TO OUTSIDE AND LOW LEVEL ALARM.
8	TERMINEX LOUVER (N.A)	TRANSFORMER VAULT	MM x MM	C/W BIRDSCREEN LOCATED 450MM ABOVE OUTSIDE GRADE.
9	SUMMIT LOUVER (N.A)	TRANSFORMER VAULT	MM x MM	C/W BIRDSCREEN LOCATED 300MM BELOW CEILING.
10	SUMMIT LOUVER	LAUNDRY ROOM	1200 MM x 300MM DEEP	SUPPLY BY GENERAL CONTRACTOR. COVER BY PLUMBING CONTR. C/W HIGH LEVEL & LOW LEVEL ALARM.
11	WINDOWLOUVER EXHAUST UNIT	HOUSEKEEPING ROOM, SECOND FLOOR	100 CFM	TO BE C/W TO OUTSIDE LOUVER C/W BIRDSCREEN OF TERMINATE WITH INSINOUL WALL CAP C/W INSULATION ON FUEL TRAP AND BACKDRAFT DAMPER. MM x MM
12	EXH. S.F. LOUVER (N.A)	LAUNDRY ROOM	MM x MM	C/W BIRDSCREEN AND BACKDRAFT DAMPER LOCATED 300MM BELOW CEILING.
13	ADD MECHANICAL STATION AND METER	EXTERNAL TO BUILDING	LENGTH 1200MM & DEPTH 300MM	EXACT LOCATION TO BE DETERMINED BY HYDRO & OWNER'S REPRESENTATIVE.
14	FIRE DEPARTMENT SIAMESE CONNECTION		DIAM x DEPTH x 150MM	TO BE INSTALLED MINIMUM 900MM AND 1200MM MAXIMUM ABOVE GRADE AND ASSESSED FROM NEAREST FIRE HYDRANT.

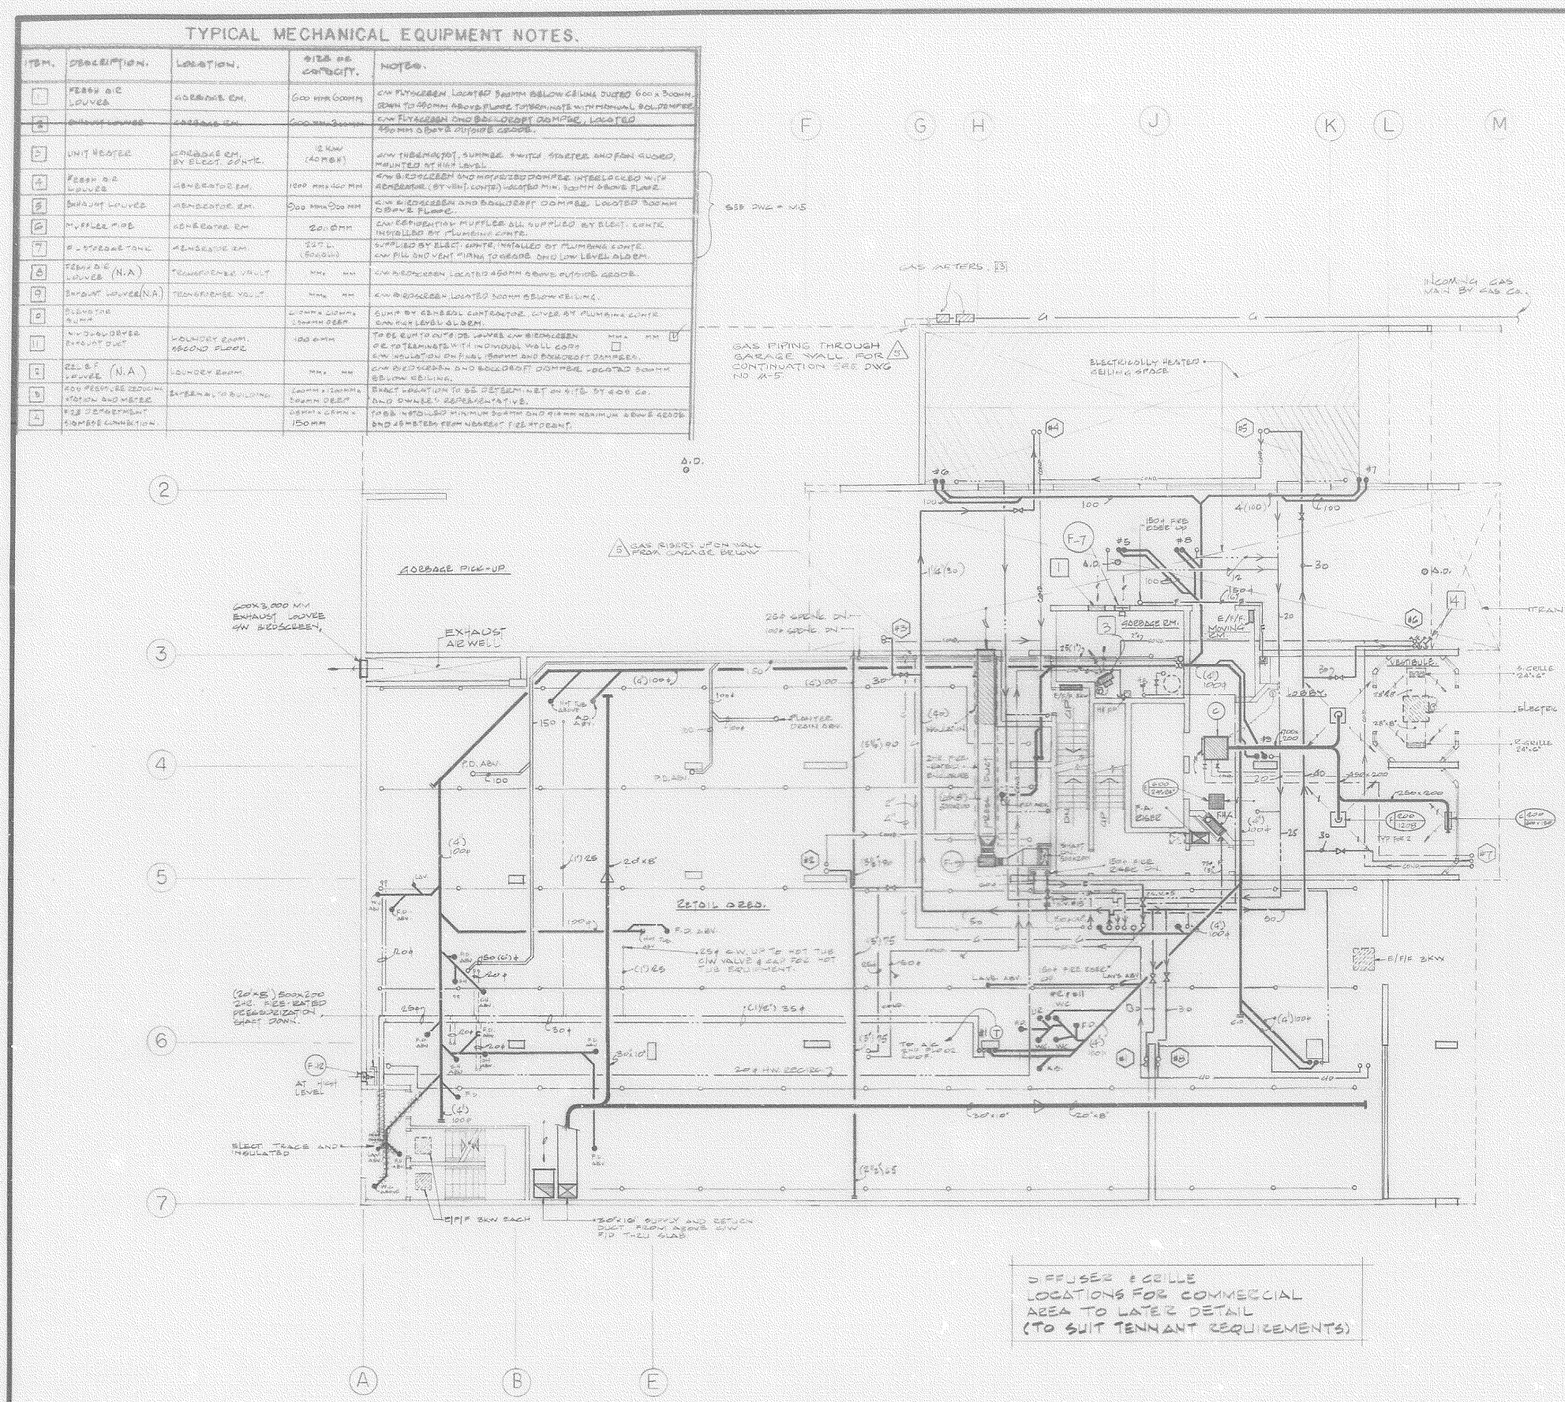

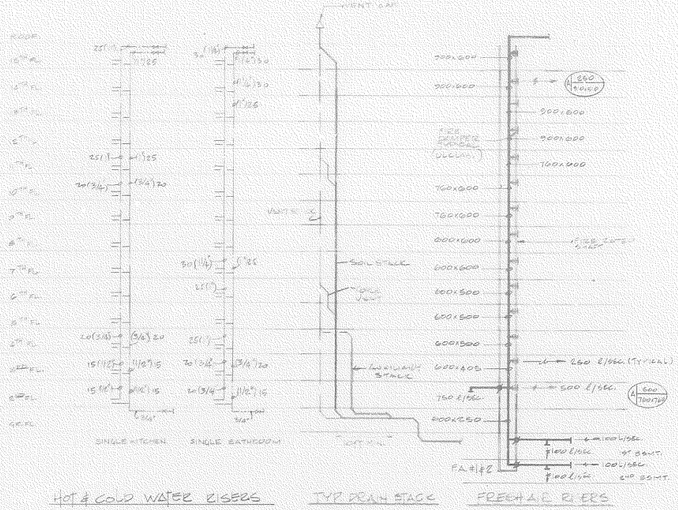

HOT & COLD WATER RISERS — TYP DRAIN STACK — FRESH AIR RISERS

BATH/LAUNDRY USE KITCHEN USE
DOUBLE BATH / SINGLE KITCHEN

BRANCH SIZES
FOR DOMESTIC HOT AND COLD WATER

UNIT	HOT INCHES/MM	COLD INCHES/MM
SINGLE KITCHEN	1/2" 13MM	1/2" 13MM
DOUBLE KITCHEN	1/2" 13MM	1/2" 13MM
SINGLE BATHROOM	1/2" 13MM	1/2" 13MM
COMBINATION: BATHROOM-KITCHEN	1/2" 13MM	1/2" 13MM
INDIVIDUAL WASHER	1/2" 13MM	1/2" 13MM
DOUBLE BATHROOM	1/2" 13MM	1/2" 13MM
DOUBLE BATHROOM KITCHEN	3/4" 19MM	3/4" 19MM
THREE OR MORE BATHROOMS	3/4" 19MM	3/4" 19MM

NO.	DATE	DESCRIPTION	DWN.	CHD.
5	APR. 10 1981	GAS PIPING REVISED AS PER C.N. #3	P.C.	P.C.
4	FEBR. 19 '81	REVISED AFTER C.N. #2	M.G.	L.A.
3	SEPT. 2/80	ISSUED FOR ADDENDUM #3		L.A.
2	JULY 10/80	ISSUED FOR TENDER	P.C.	L.A.
1	JUNE 7/80	RE-ISSUED FOR PERMIT	P.C.	L.A.

DESTROY ALL PRINTS DATED PREVIOUS TO FINAL DATE ABOVE.

REVISIONS

THIS DRAWING SHALL ONLY BE USED WHEN SIGNED FOR THE PURPOSE SPECIFIED BELOW.

FOR	DATE	CHECKED BY
CONSTRUCTION		
TENDER	JULY 10, 1980	L.A.
PERMIT	28 NOV. 1979	L.A.

SUBMISSIONS

THE SPECIFICATIONS ARE TO BE CONSIDERED AS AN INTEGRAL PART OF THESE DRAWINGS AND NEITHER THE DRAWINGS NOR THE SPECIFICATIONS SHALL BE USED ALONE.

THESE DRAWINGS ARE THE PROPERTY OF THE ENGINEER AND MUST BE RETURNED AT COMPLETION OF WORK OR UPON REQUEST.

THE INTERSIGN ENGINEERING CORP. LTD.
CONSULTING ENGINEERS
TORONTO CALGARY
REGISTERED PROFESSIONAL ENGINEER V. KNOP PROVINCE OF ONTARIO

PROJECT:
54 UNITS
RESIDENTIAL/COMMERCIAL
254 JARVIS STREET
TORONTO ONTARIO
FOR STASH INVESTMENT INC.

TITLE:
GROUND FLOOR LAYOUT

DRAWN BY	CHECKED BY	PROJECT NO.
M.G.	L.A.	79-095
SCALE: 1:100		DRAWING NO. M-6
DATE: NOV. 1979		OF 11