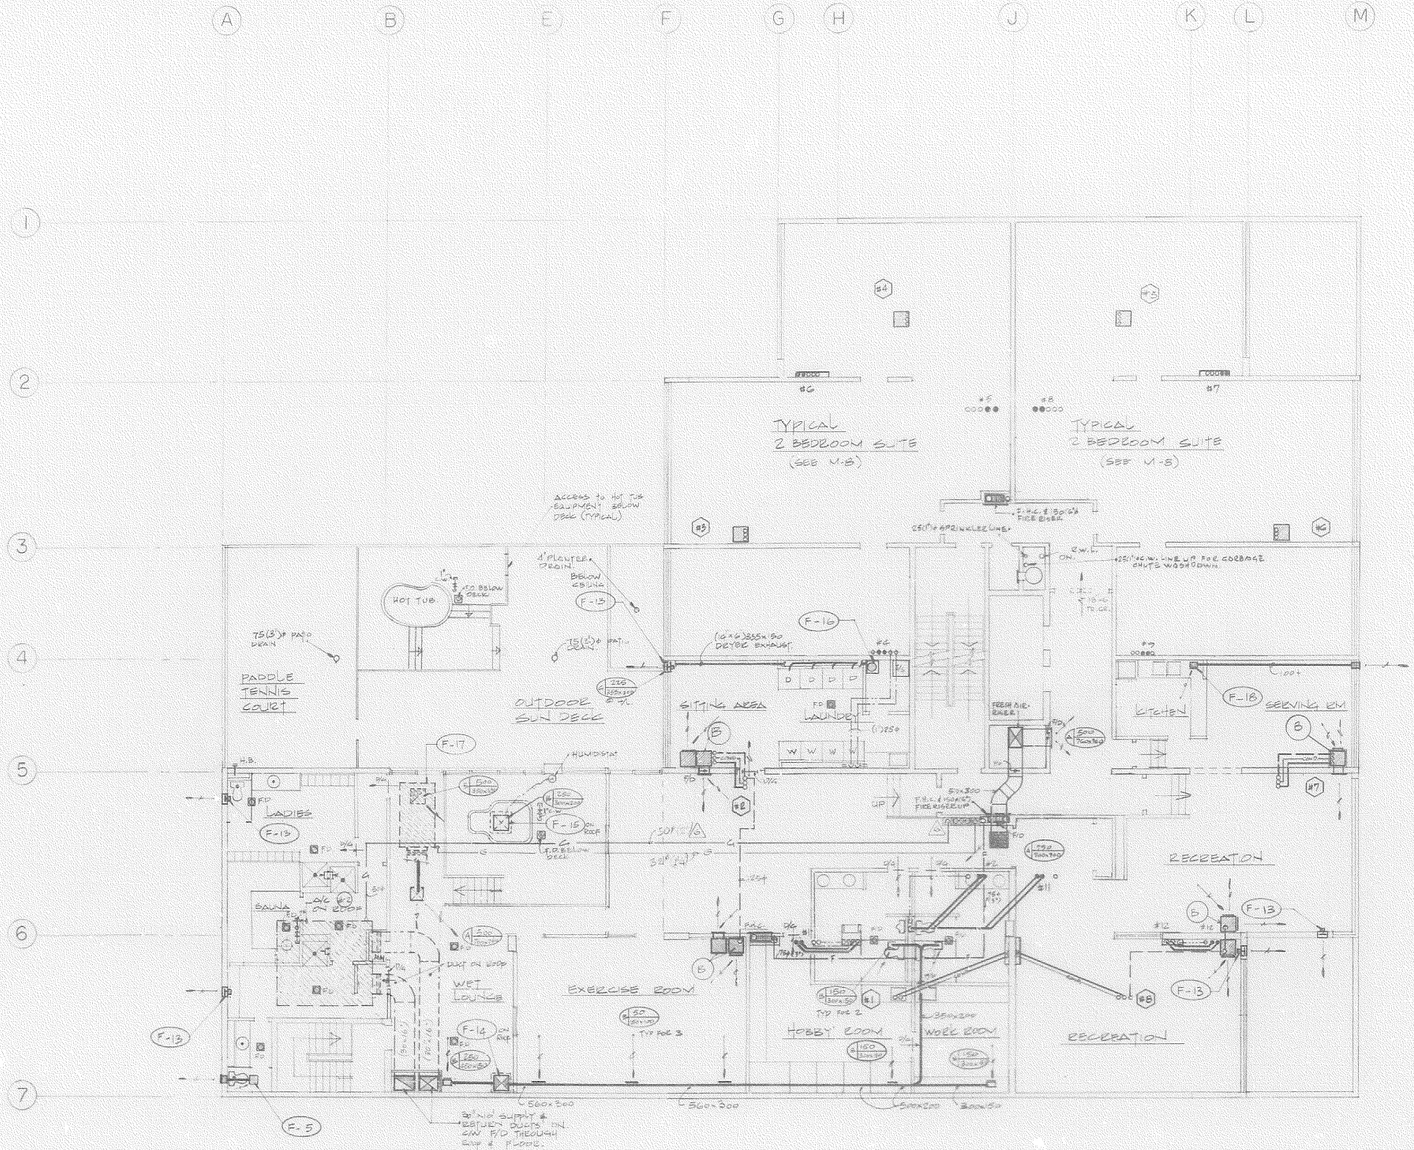

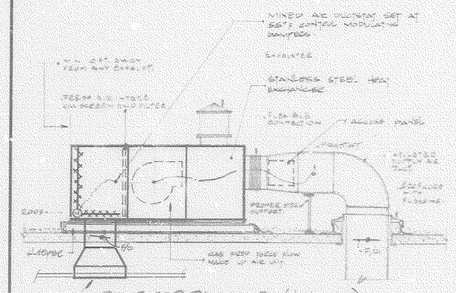

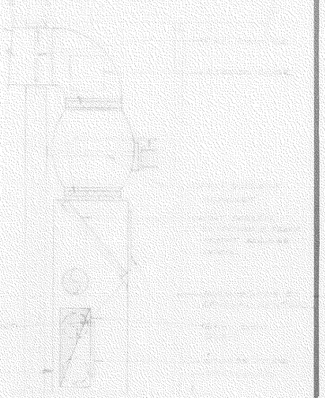

DETAIL OF DRYER EXHAUST FAN (F-16)
N.T.S.
(COMPLETE SYSTEM BY VENTILATION CONTRACTOR)

NO.	DATE	DESCRIPTION	DWN.	CHD.
D.	NOV. 10, 1981	EAS PIPING REVISED AS PER ADDENDUM #3	V.K.	V.K.
C.	FEBRUARY 19, 1981	REVISED PAVING CH. #2	M.S.	L.W.
4	SEPT. 26, 80	REVISED AS PER ADDENDUM #2	T.L.	T.L.
3	SEPT. 4, 80	ISSUED FOR ADDENDUM #2.		L.A.
2	JULY 9, 80	ISSUED FOR TENDER	P.E.	L.A.
1	JUNE 7, 80	RE-ISSUED FOR PERMIT	P.E.	L.A.

DESTROY ALL PRINTS DATED PREVIOUS TO FINAL DATE ABOVE.

REVISIONS

THIS DRAWING SHALL ONLY BE USED WHEN SIGNED FOR THE PURPOSE SPECIFIED BELOW

FOR	DATE	CHECKED BY
CONSTRUCTION		
TENDER	JULY 10, 1980	L.A.
PERMIT	NOV. 28, 1979	L.A.

SUBMISSIONS

THE SPECIFICATIONS ARE TO BE CONSIDERED AS AN INTEGRAL PART OF THESE DRAWINGS AND NEITHER THE DRAWINGS NOR THE SPECIFICATIONS SHALL BE USED ALONE.

THESE DRAWINGS ARE THE PROPERTY OF THE ENGINEER AND MUST BE RETURNED AT COMPLETION OF WORK OR UPON REQUEST.

THE INTERSIGN ENGINEERING CORP. LTD.
CONSULTING ENGINEERS
TORONTO CALGARY

REGISTERED PROFESSIONAL ENGINEER V. KNOP

PROJECT
54 UNITS
RESIDENTIAL/COMMERCIAL
254 JARVIS STREET
TORONTO ONTARIO
FOR STASH INVESTMENT INC.

TITLE
SECOND FLOOR LAYOUT

DRAWN BY	CHECKED BY	PROJECT No.
M.S.	L.A.	79-095
SCALE		DRAWING No.
1:100		M-7
DATE NOV. 1979		OF 11