


DETAIL OF DRAIN TRAP NTS


FAN SCHEDULE										
NO.	TYPE	LOCATION	CFM	HP	SP. PRESS.	HP	SP. PRESS.	MODEL	REMARKS	REMARKS
F-1	EXHAUST	ROOF	1000	1/4	1750	1/4	1750	COOLING	UNIT 1	2-1/2\"/>

PUMP SCHEDULE										
NO.	TYPE	LOCATION	CO. PER 1/2" DIA. CM. PS	CMW	#	BLK 2500-1	MO. S	WSPR.	2500-25	
P-1	DOM. W. PUMP	BUL. EN.	20	10	1750	1/4	1200-100	2-1/2"	1/4 IN. G.	2500-25
P-2	HEAT/COOLING	—	25	30	1750	1/4	200-100	2-1/2"	2 A	500-1500 } W
P-3	—	—	25	30	1750	1/4	200-100	2-1/2"	2 A	500-1500 } PUMPING
P-4	FIRE	BUL. W. EN.	20	210	3500	20	200-100	2-1/2"	2 A	500-1500 } W
P-5	CW PUMP	—	50	220	3500	7/2	200-100	2-1/2"	1/4 IN.	500-1500 } 70W-1000-1500
P-6	—	—	50	220	3500	7/2	200-100	2-1/2"	1/4 IN.	500-1500 } 70W-1000-1500
P-7	CANTON PUMP	—	00	40	1750	3	200-100	2-1/2"	5-1000	DUPLEX
P-8	5000 SWP	—	00	40	1750	3	200-100	—	5-1000	DUPLEX
P-9	5000 SWP	—	50	40	1750	3	—	—	5-1000	DUPLEX
P-10	5000 SWP	—	7	210	1750	3	200-100	2-1/2"	7-100	W. CONTROLLER
P-11	EXCESS PRESS. PUMP	—	10	NOTE	SPRINKLER SYSTEM & WATER PRESS.					


GRILLE SCHEDULE.				
NO.	DESCRIPTION	AMPERE	TYPE	REMARKS
G-1	SUPPLY GRILLE to the MOTOR	YES	1/4"	3-5-7-8
E-1	EXHAUST & RETURN	NO	1/4"	1-7-8-9
G-2	SUPPLY	YES	1/4"	1-2-4-7
D-1	TECH GRILLE	NO	1/4"	1-2-8-7-9
E-2	EXHAUST GRILLE to the	NO	1/4"	2-5-7-9
E-3	OFF GRILLE	YES	1/4"	3-5-6
G-3	LOUVER	NO	-	NO 50% 2-5-6-7-8-9
H-1	DOOR COLLS	NO	1/4"	1-9-10

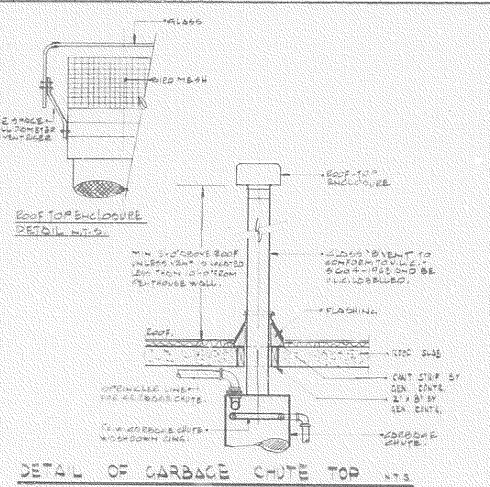


DETAIL OF GARABGE CHUTE TOP NTS

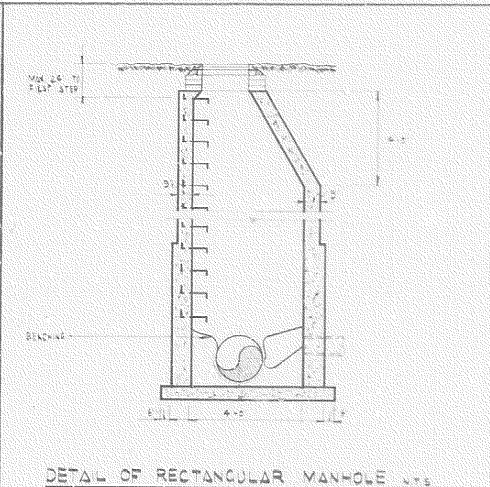


DETAIL OF RECTANGULAR MANHOLE NTS

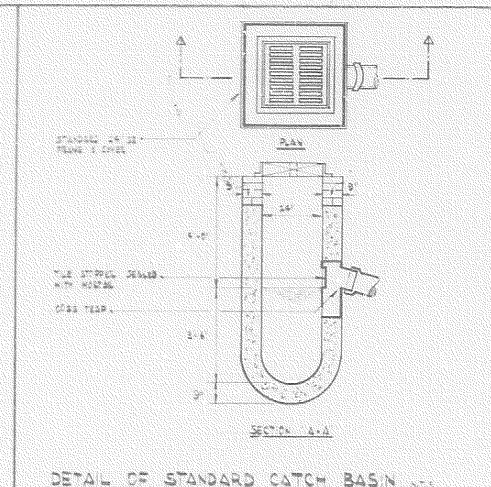


DETAIL OF STANDARD CATCH BASIN NTS

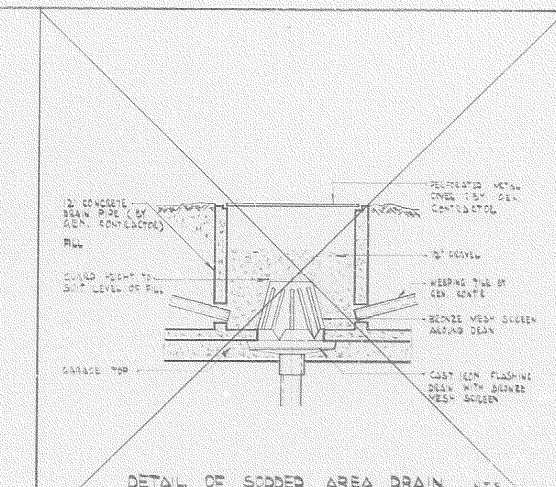


DETAIL OF SODDED AREA DRAIN NTS

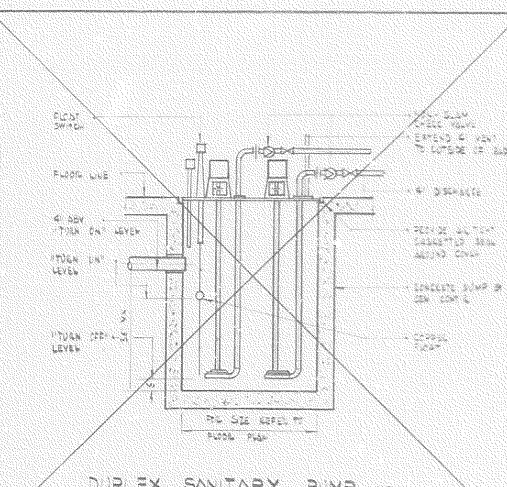


DUPLIX SANITARY PUMP NTS

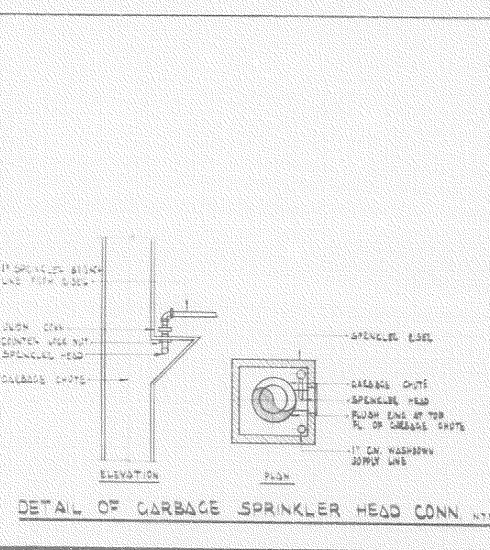


DETAIL OF GARABGE SPRINKLER HEAD CONN NTS

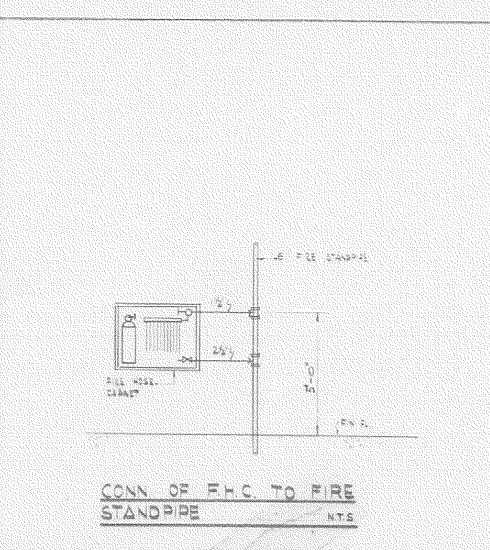


CONN. OF F.H.C. TO FIRE STANDPIPE NTS

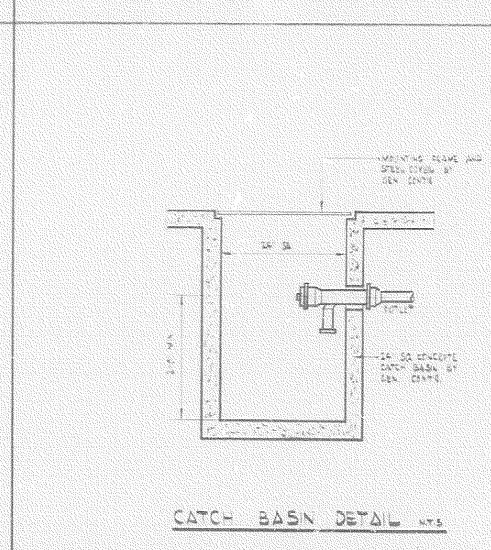

CATCH BASIN DETAIL NTS

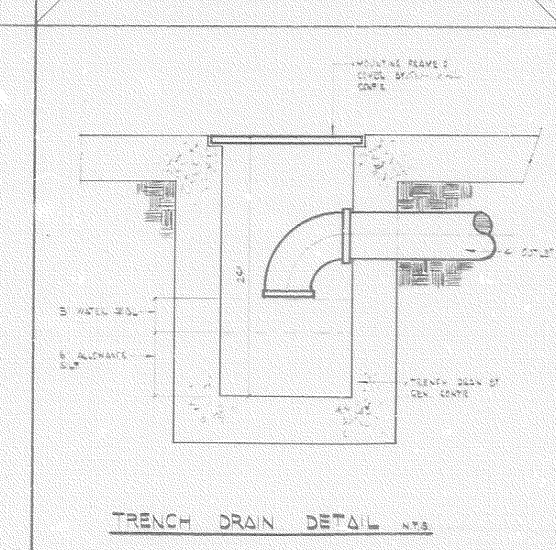

TRENCH DRAIN DETAIL NTS

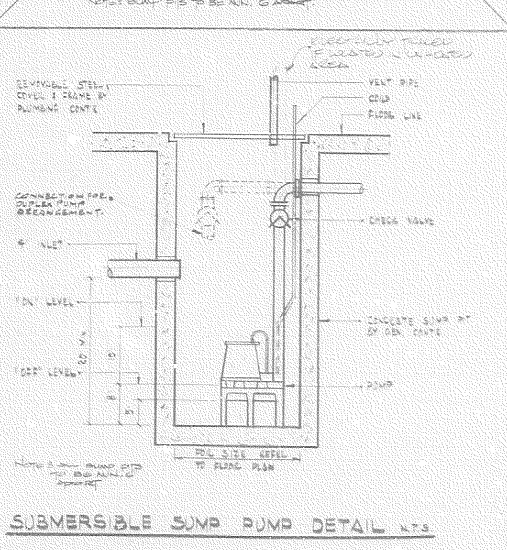

SUBMERSIBLE SUMP PUMP DETAIL NTS

3	SECT. 20	CR. 1150 AS PER APPENDIX 4	T.L.T.L.
2	SECT. 20	CR. 1150 AS PER APPENDIX 4	P.L.A.
1	SECT. 20	CR. 1150 AS PER APPENDIX 4	P.L.A.
NO.	DATE	DESCRIPTION	OWN. CHG.
REVISIONS			
THIS DRAWING SHALL ONLY BE USED WHEN SIGNED FOR THE PURPOSE SPECIFIED BELOW			
CONSTRUCTION	JULY 10, 1980	L.A.	
TENDER	28 JULY 1979	L.A.	
PERMIT			
FOR	DATE	CHECKED BY	
SUBMISSIONS			
THE SPECIFICATIONS ARE TO BE CONSIDERED AS AN INTEGRAL PART OF THESE DRAWINGS AND NEITHER THE DRAWINGS NOR THE SPECIFICATIONS SHALL BE USED ALONE			
THESE DRAWINGS ARE THE PROPERTY OF THE ENGINEER AND MUST BE RETURNED AT COMPLETION OF WORK OR UPON REQUEST			
THE INTERSIGN ENGINEERING CORP. LTD. CONSULTING ENGINEERS TORONTO CALGARY			
PROJECT 54 UNITS RESIDENTIAL COMMERCIAL 254 JARVIS STREET FOR STASH INVESTMENTS INC. TORONTO ONTARIO			
TITLE DETAILS & SCHEDULES			
DRAWN BY U.S.	CHECKED BY L.A.	PROJECT NO. 79-095	
SCALE N.T.S.		DRAWING NO. M-9	
DATE NOV. 1979		OF 11	