

KEY PLAN
(N.T.S.)

PROPERTY LINE

FIXTURE OVER RAMP TO BE 175 W. MERC. VAPOUR FIXTURE HOLOPHANE # 417-120V (CCT # B-1)

2 # 12 TO GARAGE DOOR OPERATOR

3 CONDUIT PVC CABLE TO BE TYPE RWU90 FROM PANEL AT APPROX 10'-0" A.F.F. RUN ONCE ALONG TOP AT BOTTOM OF RAMP

RAMP DOWN

KEY SW TO OPERATE GARAGE DOOR EXACT LOCATION TO BE DETERMINED BY ARCHITECT ON SITE.

SK

HIGH VOLTAGE DUCTBANK EXACT ROUTING AND TERMINATION TO SUIT HYDRO.

LINE OF GARAGE BELOW

LINE OF GARAGE BELOW

EMERGENCY GENERATOR ROOM BELOW

TRANSFORMER VAULT TO PUC REQUIREMENTS (PUC DWG # 7605-D-8 (11'-0" X 7'6" X 10'-0" HEADROOM)

4" CONDUIT FOR T.V. & 2" CONDUIT FOR CABLE TV EXACT ROUTINGS TO SUIT SUPPLIERS.

15 STOREY 54 SUITE APARTMENT TOWER

LINE OF TOWER ABOVE

EXISTING CONCRETE HYDRO POLE

MUTUAL STREET

JARVIS STREET

ALLOW FOR THE INSTALLATION AND WIRING OF 10 LANDSCAPE LIGHTING FIXTURES. EXACT LOCATION TO BE DETERMINED AT A LATER DATE. (CCTS. FROM PANEL 'B')

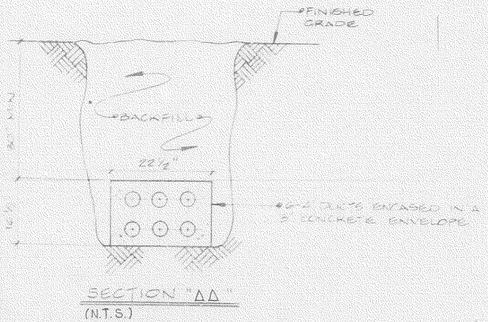

SECTION "AA"
(N.T.S.)

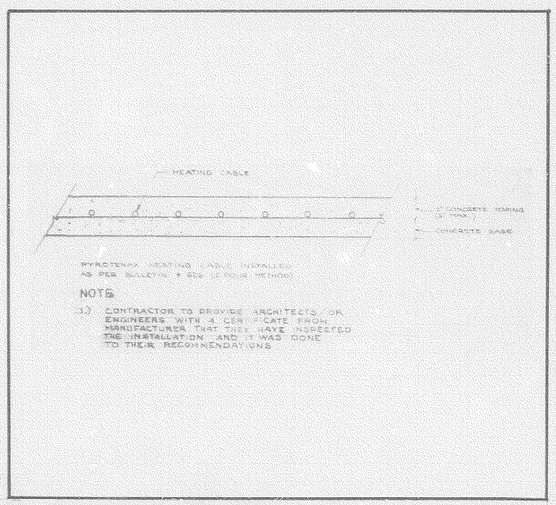

① TYPICAL RAMP SECTION

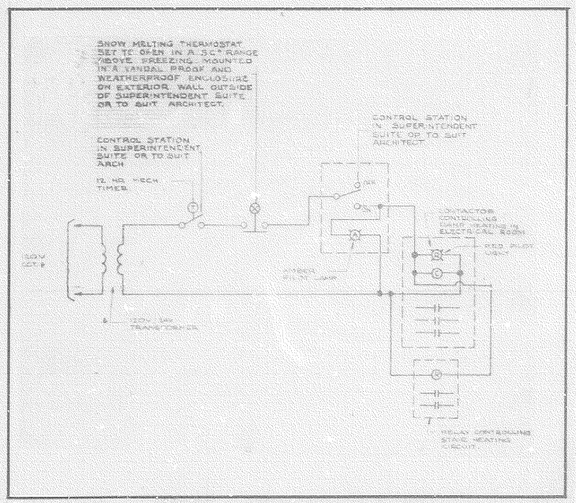

② SNOW MELTING CONTROL SCHEMATIC

NOTES

14. ALL BREAKERS SHALL BE 15 A. 1 POLE UNLESS NOTED OTHERWISE.

NO.	DATE	DESCRIPTION	DWN	CH'D
1	JUNE 5 1980	REISSUED FOR PERMIT	L.A	L.D

DESTROY ALL PRINTS DATED PREVIOUS TO FINAL DATE ABOVE.

REVISIONS

THIS DRAWING SHALL ONLY BE USED WHEN SIGNED FOR THE PURPOSE SPECIFIED BELOW.

CONSTRUCTION		
TENDER		
PERMIT	NOV 23, 1979	
FOR	DATE	CHECKED BY

SUBMISSIONS

THE SPECIFICATIONS ARE TO BE CONSIDERED AS AN INTEGRAL PART OF THESE DRAWINGS AND NEITHER THE DRAWINGS NOR THE SPECIFICATIONS SHALL BE USED ALONE.

THESE DRAWINGS ARE THE PROPERTY OF THE ENGINEER AND MUST BE RETURNED AT COMPLETION OF WORK OR UPON REQUEST.

THE INTERSIGN ENGINEERING CORP. LTD.
CONSULTING ENGINEERS
TORONTO CALGARY
V. KNOP

PROJECT:
53 UNITS
RESIDENTIAL/COMMERCIAL
254 JARVIS STREET
FOR STASH INVESTMENTS INC.
TORONTO ONTARIO

TITLE:
SITE PLAN

DRAWN BY:	CHECKED BY:	PROJECT No.
PS LD		79-095
SCALE: 1:100		DRAWING No. E-1
DATE: NOV. 1979		OF 8